


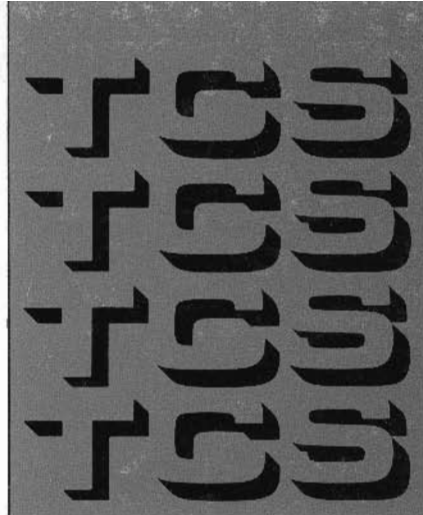


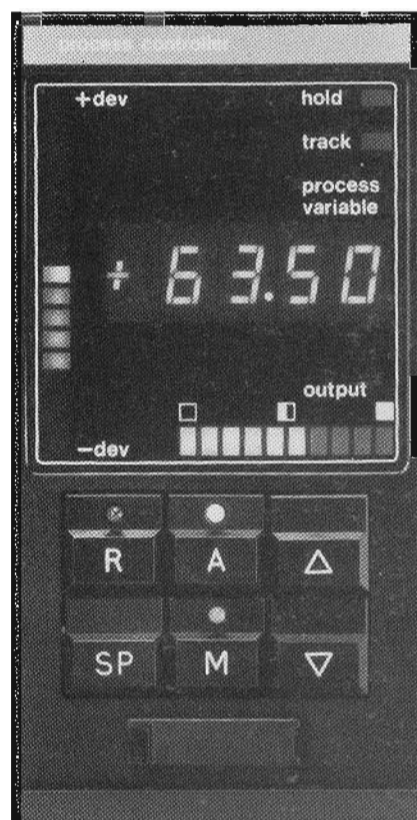

process controller

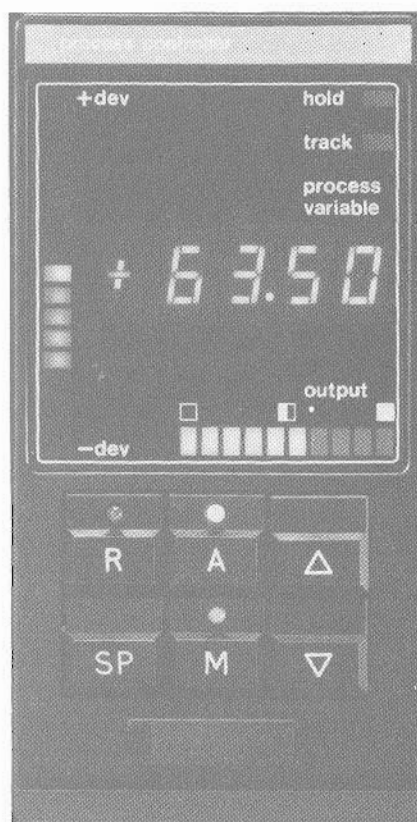

system  
6000  
**6350**

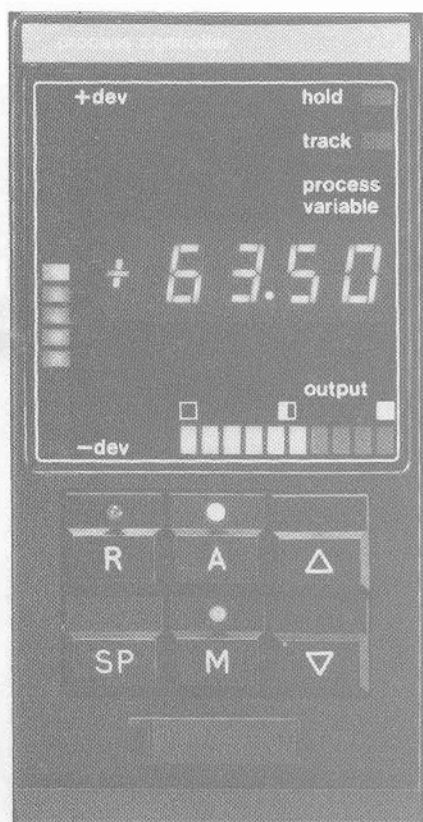

product  
specification

## 3-term and ratio controller: Features

- No options.
- All controllers are identical and interchangeable.
- Single loop integrity.
- Built-in diagnostic routines.
- PID, Ratio or ON/OFF control.
- Microprocessor technology and solid state displays.
- Remote monitoring and supervision via a simple serial link.
- Field proven unit with a two-year warranty.
- Fully compatible with the TCS range of advanced instrumentation.

## Description

The 6350 single loop process controller combines the flexibility of modern microprocessor technology with the integrity associated with conventional analogue instruments.

A microprocessor is incorporated in every 6350 enabling a user to characterise each device for any 3-term, ratio or ON/OFF control loop function using a simple plug-in hand-held terminal. As the loop characteristics are defined by easily changed parameters all 6350 controllers are identical and interchangeable regardless of application. One 6350 is a spare for all the others on a plant as its function is defined and changed by the technician via the hand-held terminal. Use of the terminal ensures security of the settings

which are retained indefinitely when the device is powered and for at least five years if unpowered.


Functionally the controller operates as a conventional analogue unit providing facilities to raise/lower the setpoint, ratio or output, via front panel push-buttons and to change control mode to Manual, Automatic, Remote (for cascade connection) or Ratio. The 6350 will interface to 4-20mA signals from plant mounted equipment or 0-10V signals from the System 6000 range of signal conditioners and output drivers.

Each controller has a suite of input linearisation routines and TCS will provide custom linearisation at an additional cost. As well as providing a control output the 6350 generates

0-10V signals representing the linearised process variable and the setpoint or error deviation.

Supervision and monitoring of the 6350 is made particularly simple by the provision of a communications interface. This allows an intelligent device to monitor or update any of the control parameters of a network of 6350 controllers via an RS422 serial bus using a standard ANSI protocol. The use of a TCS 8245 Communications Buffer Unit enables RS232, TTL and fibre optic interfaces to be implemented.

The solid state technology offers high levels of reliability while the diagnostic procedures built into each instrument provide further output integrity.

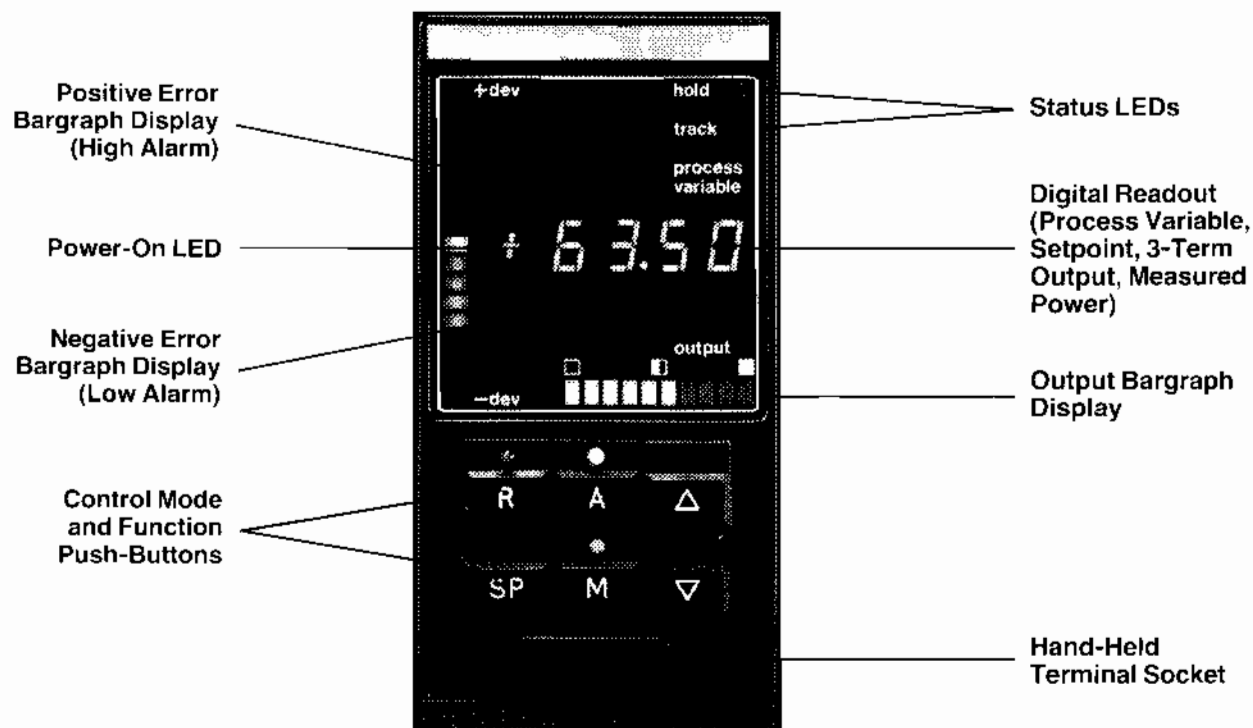

## Operator displays and controls

### Operator displays

#### Digital Readout

(for process variable, setpoint, 3-term output and measured power indication)  
4-digit, orange LED display with sign and decimal point.

#### Error Indication

Vertical red LED bargraphs with 8 segments for positive and negative error in 1% steps.

#### Alarm Indication

High or low alarms indicated by flashing positive or negative error bargraphs.

#### Zero Error and Power-on Indication

Green LED in centre of error bargraph.

### 3-Term Output or Measured Power Display

Horizontal yellow LED bargraph with 10 segments to indicate 0-100% output.

#### Status Indicators

2 yellow rectangular LEDs to indicate TRACK and HOLD status.

### Operator controls

#### Control Mode Selection

3 illuminated push-buttons:

Manual (M) with integral yellow LED.  
Local Auto (A) with integral green LED.  
Remote Auto or Ratio (R) with integral green LED.

### Function Selection

2 non-illuminated push-buttons:

Raise (▲) increments the output when Manual (M) is pressed, or increments the setpoint when (SP) is pressed.  
Lower (▼) decrements the output when Manual (M) is pressed, or decrements the setpoint when (SP) is pressed.

#### Display Selection

1 non-illuminated push-button (SP) causes the digital readout to display the current setpoint while pressed.

**NOTE:** Pressing the Manual, Auto or Remote buttons causes the digital readout to display the current output level or the measured power.

Gas pressure control  
Extruder control  
Boiler control  
Brewing vessel control  
Environmental chambers  
Turbine test beds

Ethylene oxide plant  
Hydrofluoric acid plant  
Glass manufacture  
Paper production  
Cement production  
Blast furnaces

Reheat furnaces  
Adhesive coating line control  
Paint oven control  
Oil production platforms  
Viscose yarn production  
Glycerine manufacture

Comprehensive system interlocks are then made which result in all control mode selections being both bumpless and procedureless. Typical complex loops of this type are the Cascade and Ratio configurations illustrated below.


The example shows a process temperature being controlled through a secondary fuel flow loop using two 6350 controllers. To effect bumpless and procedureless switching between Remote, Auto and Manual on the

secondary controller will track the remote setpoint value as long as it is in Remote. In addition an option switch allows the local setpoint of each controller to track its own process variable while it is in Manual.



The fuel flow is measured and linearised within the combustion air controller where the ratio and bias functions are executed to generate the correct

setpoint to maintain the desired relationship between fuel and air flows. The combustion air controller also linearises an input from an oxygen monitor and uses this to trim the ratio setting to ensure efficient combustion.

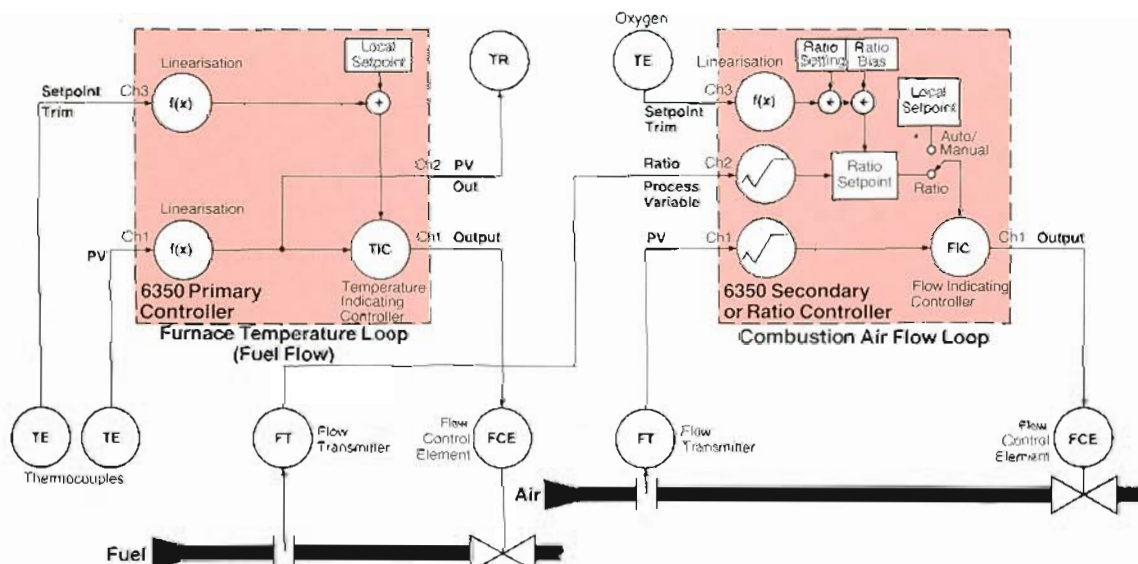

# Communications

Every System 6000 microprocessor based instrument is fitted with an RS232 port and an RS422 port for serial data communications. The RS232 port is available via a front-panel socket and is

used for the 8260 Hand-held programming terminal. The RS422 port is available on the module rear connector pins and is bussed onto the supervisory data link common to all

modules. All parameters that can be monitored via the 8260 terminal can also be accessed and updated via the supervisory data link.

## Hand-held terminal link

Each System 6000 instrument can be set up using a plug-in 8260 Hand-held terminal. Every parameter is accessed by means of a simple 2 character command mnemonic and all data is entered directly in engineering units. This technique ensures the accuracy and security of parameter settings.

### Specification

#### Transmission Standard

2-wire RS232/V24 (+12V).

#### Data Rate


300 baud.

#### Character Length

10 bits made up of:

1 start + 7 data + 1 parity (even)

- 1 stop.

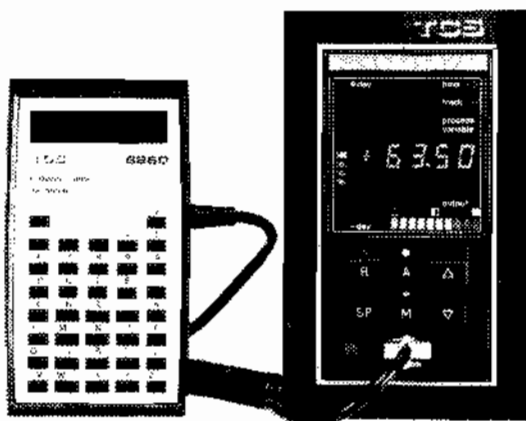


The photograph shows an 8260 terminal plugged into the front-panel of a 6350 controller. A full list of the available command parameters is given in the 6350 Facts Card.

## Multi-drop supervisory link

Every System 6000 instrument contains an RS422 communications port which enables it to send and receive command parameters over a simple four-wire link connected to other intelligent devices. The use of RS422 and the transmission of information in ASCII or Binary data format makes it particularly easy to

communicate with the 6350 controller. To hook the 6350 into a distributed control system requires no modification to the instrument and no further expenditure on options. The four-wire link is simply connected up so that the 6350 becomes part of the distributed control system. The illustration shows

how an array of 6350s can be directly connected to a supervisory computer which has an RS422 serial port. If the computer only has an RS232 serial port then an 8245 Communications Buffer Unit can be used to carry out the required RS232 to RS422 conversion as shown.

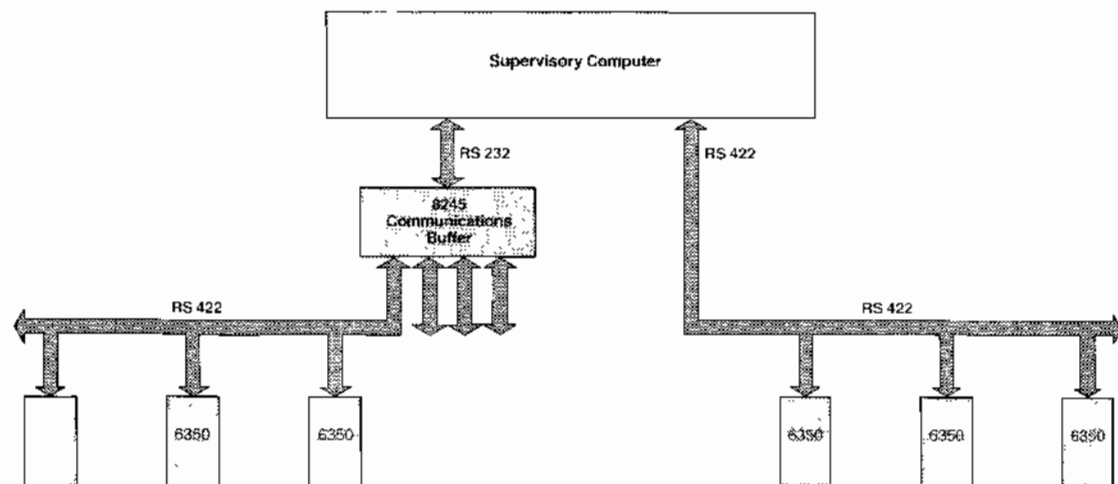

### Specification

#### Transmission Standard

4-wire RS422 (0-5V).

#### Line Impedance

120-240Ω twisted pair.

#### Line Length

4000 ft max. (at 9600 baud).

#### Number of Units/Line

16.

#### Data Rate

Selectable from 110, 300, 600, 1200, 2400, 3600, 4800, or 9600 baud

#### Character Length (ASCII/Binary)

10/11 bits - 300 to 9600 baud.

11/12 bits - 110 baud (2 stop)

## Protocol

All microprocessor based instruments in the System 6000 range employ a standard ANSI protocol known as BI-SYNCH. The exact form of BI-SYNCH implemented within System 6000 corresponds with the American


National Standard specification:

ANSI-X3.28-2.5-A4 Revision 1976

TCS have implemented both an ASCII and Binary version of this protocol within each instrument

The ASCII mode is simplest to use as all data is transmitted in ASCII characters. The Binary mode offers a 4 to 1 increase in transmission speed by compressing the data into a binary format, and also supports additional features like Multi-Parameter and Enquiry Polling.

# Input/Output signals

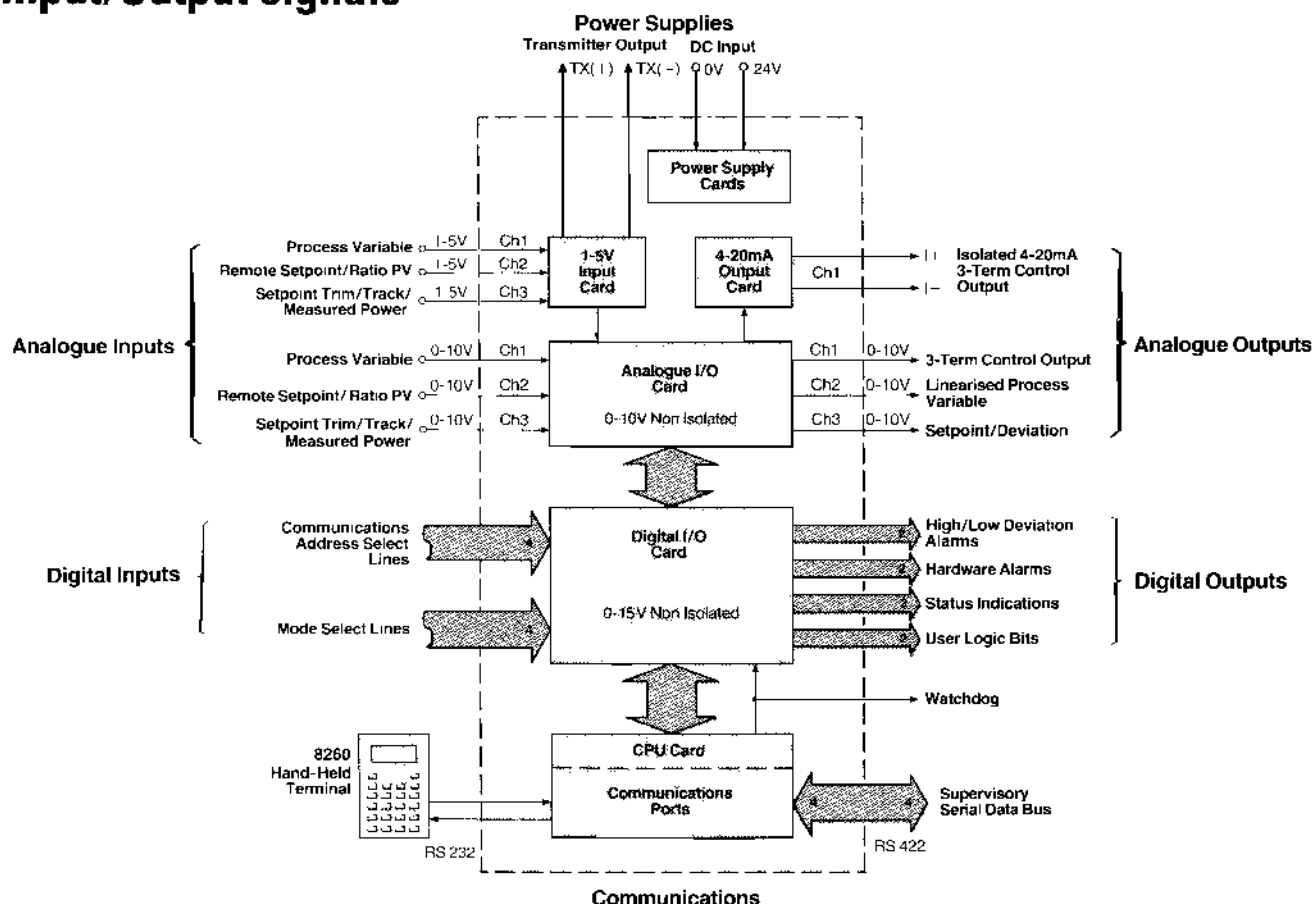

## Analogue inputs

### Number of Channels

3 direct non-isolated inputs or 3 conditioned non-isolated inputs.

### Channel Functions

Channel 1 = Process Variable input.  
Channel 2 = Remote Setpoint/Ratio Process Variable input.  
Channel 3 = Setpoint or Ratio Trim/Track/Measured Power input.

### Input Signal Levels

Direct inputs are 0-10V range, conditioned inputs are 1-5V or 4-20mA range with external sense resistors.

### Resolution

12 bit binary ADC (.025%) hardware applied to inputs.  
15 bit binary representation obtained after digital input filtering and signal averaging giving resolution of 1 digit in  $\pm 9999$ .

### Accuracy

$\pm 1$  LSB typ. over 0-50°C range for hardware.  
 $\pm 1$  digit of reading for 0-4000 range.  
 $\pm 2$  digits of reading for 0-8000 range.  
 $\pm 3$  digits of reading for 0-9999 range, after input filtering.

### Sampling Rate

ADC samples 1 channel every 12ms, i.e. any one channel is sampled once every 36ms.

### Input Impedance

1M $\Omega$  pull-down to -5V on channel 1.  
1M $\Omega$  pull-down to 0V on channels 2 and 3.

### Input Signal Processing

Linear (normal or inverse).  
Normalised square root  
Type J, K, T, S, R, E, B thermocouples.  
Platinum resistance thermometers.  
User specified linearisation functions.

## Analogue outputs

### Number of Channels

3 direct non-isolated outputs plus 1 isolated output.

### Channel Functions

Channel 1 = 3-Term control output.  
Channel 2 = Process Variable output.  
Channel 3 = Setpoint output or amplified deviation (error).

### Output Signal Levels

Direct outputs are 0-10V range. Isolated output is 4-20mA (channel 1 only).

### Output Circuit Type

Medium-term analogue sample-and-hold circuits preceded by DAC.

### Output Resolution

12 bit binary (.025%) giving minimum analogue voltage steps of 2.5mV.

### 0-10V Output Accuracy

$\pm 1$  LSB typ. over 0-50°C range.

### Isolated Output Accuracy

$\pm 0.5\%$  of full scale.

### Sample and Hold

DAC updates 1 channel every 12ms, i.e. any one channel is refreshed once every 36ms.

### Output Drift Rate Under Watchdog

$\frac{1}{2}$  mV/sec maximum (equivalent to 1% of full scale in 3 minutes).

### Output Drive Capability

$\pm 5$ mA for direct voltage outputs.

### Isolation Voltage

$\pm 50$ V minimum with respect to system ground.

## Digital inputs

### Number of Inputs

8 external non-isolated inputs.

### Input Functions

4 communications unit address select lines.  
4 mode select lines.

### Input Voltage Levels

15V = logic one.  
0V = logic zero.

### Input Impedance

100k $\Omega$  pull-down to 0V (gives 150 $\mu$ A logic one current).

## Digital outputs

### Number of Outputs

8 external non-isolated outputs plus Watchdog.

### Output Functions

2 deviation alarms.  
2 hardware alarms.  
2 status indications.  
2 user logic bits.

### Output Voltage Levels

15V = logic one.  
0V = logic zero.

### Output Drive Capability

2k $\Omega$  open-collector pull-up to +15V supply, maximum logic zero sink current = 16mA.

## 3-term control characteristics

### Algorithm Sampling Period

36ms to 1.56s dependent upon integral and derivative times.

### Setpoint

range—low, high—9999 to +9999.  
limits—low, high—9999 to +9999.

### Setpoint Trim

range—low, high—9999 to +9999  
in engineering units.

### Alarm Limits (on deviation)

Low, high 0 to 9999 with hysteresis of ½ % of setpoint span.

### Input Filter Range (all inputs)

0 to 99.99 sec (first order).

### Control Output

range—0 to 99.99% = 0-10V or 4-20mA (Ch1).

limits—high, low—0 to 99.99%.

polarity—inverse output mode switch selectable.

raise/lower rate in manual—0 to 99.99% in 10 sec with accelerating action.

### Proportional Band Range

0 to 999.9%.

### Integral Time Constant Range

0.04 to 99.99 sec or 0.01 to 99.99 min.  
0 = off.

### Derivative Time Constant Range

0.04 to 99.99 sec or 0.01 to 99.99 min.  
0 = off

## Power supplies

### Input Voltage

(May be unsmoothed, full-wave rectified AC).

20–30V DC recommended operating range.

19–35V DC absolute maximum input limits.

### Input Fuse Rating

2A.

### Input Current

550mA without hand-held terminal.

650mA with hand-held terminal.

### Power Failure Detect Threshold

When input voltage falls below  $16.5 \pm 2V$ .

### Remote Transmitter Supply

26V  $\pm 1.5V$  at 4mA output.

30V  $\pm 0.5V$  at 20mA output.

$\pm 50V$  minimum isolation with respect to system ground.

### Memory Standby Battery

3.0V Lithium type.

160mAh rating.

8–10 year shelf life.

5 year life typical on continuous standby.

## Mechanical details

All System 6000 microprocessor based instruments are supplied in 72mm wide metal housings fitted with front-panel

fascias and catch handles for module retention. These may be used with a wide variety of rack and panel mounting

hardware as illustrated in the examples below.

## 7000 series racks

Up to six 6350 controllers may be fitted into a 7000 series 19 inch rack as shown. Interconnections between instruments are made by wire wrapping while external connections may be brought out to 2 rows of 64 way screw terminal blocks fitted to the hinge down rear door. The 7000 series rack is also available with a panel mounting option, and a 10 inch half rack version for mounting up to three 6350s can also be supplied.



## 7900 powered sleeves

The 7900 powered sleeve allows a 6350 to be mounted with a mains power unit. This is incorporated in the associated 7350 Rear Termination Assembly which is also fitted with alarm relays and gives access to all module connections via screw terminals. The 7900 assembly is available in single, 3 way, or 6 way versions for mounting in panels from 1.5mm to 6.5mm thick. A 6 way 19 inch rack mounting version can also be supplied.



Overall dimensions in mm of housings illustrated

	7000 rack	7900 sleeve
width.	482	105
height.	177	177
depth.	380	423

Panel cut-out dimensions in mm.

	7000 rack	7900 sleeve
width:	448.2	88.2
height:	166.3	166.3

## Details

For further details refer to:

6350 Single loop microprocessor based controller technical manual.

6350 Facts Card

7350 Process Controller rear termination assembly.

7900 Single or multi-way sleeve

assembly for microprocessor based instrumentation.



Turnbull Control Systems Limited

Broadwater Trading Estate

Worthing, Sussex, BN14 8NW

Telephone: Worthing (0903) 205277 Telex: 87437

**Advanced Instrumentation**

HA075410U001  
Issue 6/C Nov 1986